

Experion Server Specification



EP03-200-300

Release 300

July 2006, Version 1.0

Revision History

Revision	Date	Description
0.1	June 2006	Preliminary publication
1.0	July 2006	Release publication

Table of Contents

1.	Product Introduction.....	1
1.1.	Experion System.....	1
1.2.	Architecture Overview.....	1
1.3.	Experion Server Overview.....	1
2.	Base Server Specifications.....	2
2.1.	Database Sizing.....	2
2.2.	Enterprise Model Sizing.....	4
2.3.	History Sizing.....	5
2.4.	Server Data Acquisition Performance.....	7
2.5.	Notification Performance.....	8
2.6.	Supervisory Control and Data Acquisition (SCADA).....	9
2.7.	Server Scripting.....	11
3.	Option Specifications.....	12
3.1.	Server Redundancy.....	12
3.2.	Distributed Systems Architecture (DSA).....	13
3.3.	OPC.....	15
3.4.	Interfaces.....	25
3.5.	Microsoft Excel Data Exchange.....	25
3.6.	Application Development Toolkit.....	26
3.7.	Application Enablers.....	27
4.	Hardware and Software Requirements.....	29
4.1.	Experion Server Computer Requirements.....	29
4.2.	Networking Requirements.....	30
4.3.	Minimum TPS System Specifications for ESVT.....	30
5.	Model Numbers.....	31
5.1.	Server Database.....	31
5.2.	Experion Server TPS Enabler.....	31
5.3.	Server Redundancy.....	32
5.4.	Distributed System Architecture.....	32
5.5.	OPC.....	32
5.6.	TDC3000 Data Hiway Integration.....	32
5.7.	Honeywell Device Integration.....	33
5.9.	SCADA Interfaces.....	33
5.10.	Microsoft Excel Data Exchange.....	33
5.11.	Application Toolkit.....	34
5.12.	Application Enablers.....	34
5.13.	Engineering Tools.....	34
5.14.	Electronic Signature.....	34
5.15.	Experion Server Hardware.....	35
6.	Glossary.....	36

1. Product Introduction

1.1. Experion System

The Experion Process Knowledge System (PKS) is Honeywell’s unified control system for process, business, and asset management that helps industrial manufacturers increase their profitability and productivity. Experion takes customers well beyond distributed control system (DCS) functionality with an advanced automation platform solution and innovative application integration to improve business performance and peace of mind.

1.2. Architecture Overview

The Experion platform comprises many different integrated hardware and software solutions depending upon the needs of the application. This pictured architecture is a representation of many of the possible nodes that can be utilized in the Experion architecture. Note that the architecture is highly scalable and not all nodes are necessary or required.

1.3. Experion Server Overview

An Experion server or redundant server combination functions as a system-wide historian and global database. The Experion server also supports communication to SCADA point sources, DSA point sources, OPC Clients and Servers and holds the system event journal, system configuration files, custom applications and server scripts. The server is the source for data, alarms, events, etc. for the client-connected applications and the Experion Station – Flex (ES-F). One or more Experion servers are required for an Experion system.


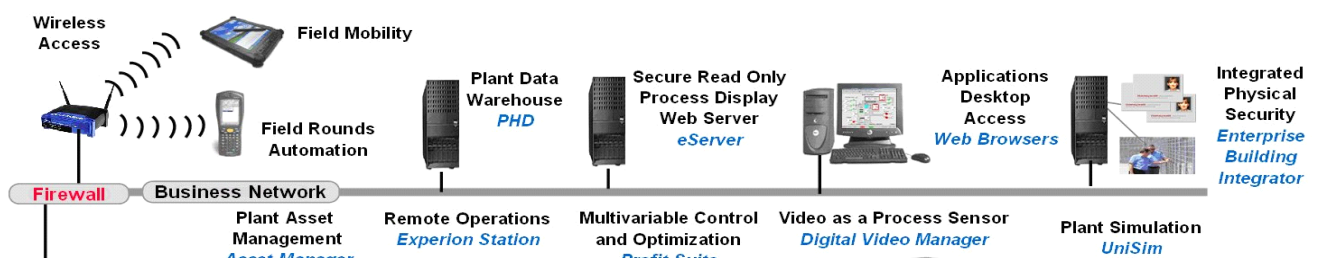


Figure 1. Sample Experion Architecture

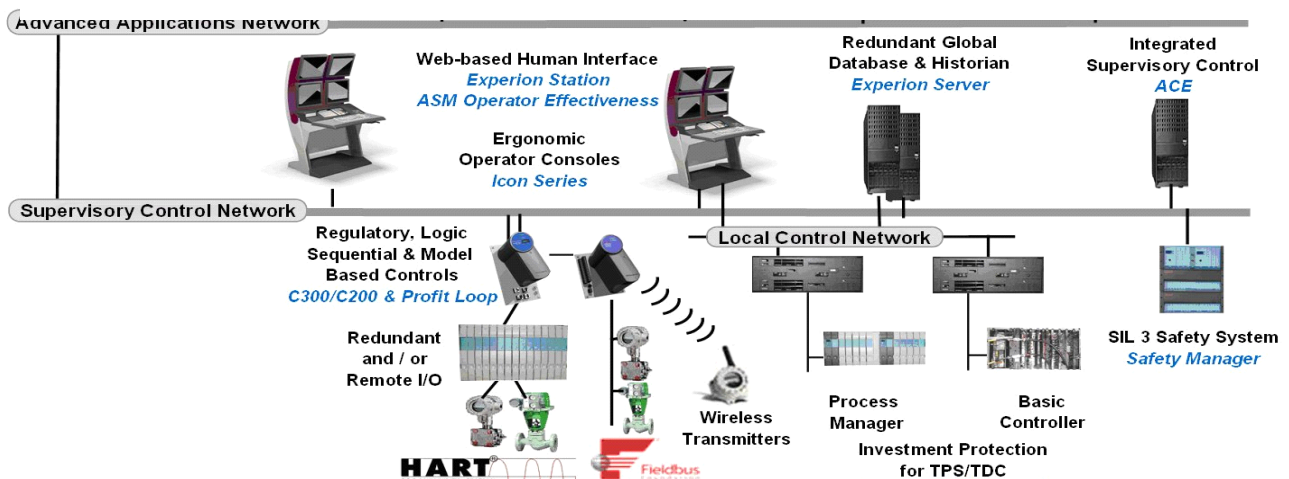

2. Base Server Specifications

2.1. Database Sizing

2.1.1. Maximum Point Count Per Server

Items	Specifications	Comments
Process Points	20,000	<ul style="list-style-type: none"> Any device that uses the Control Data Access (CDA) interface consumes process points. Examples of these devices include the ACE Node, C200 and C300 controllers etc. This is a licensed point type.
SCADA Points	65,000	<ul style="list-style-type: none"> Any points that are used to display data retrieved from SCADA Interfaces are classified as SCADA points. Examples of these devices include the Data Hiway Interface, DNP3 Protocol Interface, etc. This is a licensed point type. See section 2.6.3, Real time Database SCADA point structures, for further information on SCADA points.
Remote Data Access Points	65,000	<ul style="list-style-type: none"> Remote Data Access Points are created whenever a point is accessed using DSA that belongs to another server. Remote Data Access Points are not licensed.
TPS Points	65,000	<ul style="list-style-type: none"> Used when an Experion Server – TPS (ESVT) is getting data from a TPS system. TPS Points are not licensed.
Total of all point types	65,000	<ul style="list-style-type: none"> The maximum total number of points within a given server is 65,000. The total number of points is calculated by adding up all of the different point types listed above. The number of points in a system (a system consists of multiple servers) can exceed 65,000 points; however the number of points in any one server cannot exceed 65,000 points.
<p>Multiple Experion servers can be combined into a single operational system. Limits shown here apply to a single Experion server. Points have a composite data structure that can represent several field values. For example, you only need one analog point for a control loop that maintains the temperature of an oven, because the point's data structure can include the Process variable (PV), Output variable (OP), Set point (SP) and mode (MD).</p>		

2.1.2. Alarm, Event, Alert and Message Lists

Items	Specifications	Comments
Maximum number of active alarms and alerts	2,000	Alarms and alerts occupy the same storage space so there can be a maximum of 2,000 active alarms and alerts in the Alarm and Alert summaries.
Maximum number of active messages	1,000	Number of messages that appear in the Message summary.
Maximum number of SOE messages	32,767	Number of SOE messages that can appear in the SOE summary.
Maximum number of events in online event file	See section 2.5, Notification Performance.	<ul style="list-style-type: none"> All alarms, login actions, operator actions, and configuration changes are logged in the online event file. Up to two events are generated for every alarm, including one event for entering the alarm condition and one for return to normal.

2.1.3. Other Database Sizing Specifications

Items	Specifications	Comments
Printer Connections	50	This is the total number of printers that can be configured as either report or alarm devices.
Trend Sets	3,000	
Trend Pens per Set	32	
Trend periods	1, 5, 20 minutes 1, 2, 4, 8, 12 hours 1, 2, 5 days 1, 2, 4 weeks 3, 6 months 1 year	
Operating Groups	16,000	
Points per group	8	
Reports	1,000	
Operators	1,000	This is the default limit. The quantity can be increased to 32,000, if required.
Multiple Experion servers can be combined into a single operational system. Limits shown here apply to a single Experion server.		

2.2. Enterprise Model Sizing

2.2.1. Assets

Items	Specifications	Comments
Assets	4,000	The asset model represents the organization of items in the enterprise, for example, process units, individual pieces of equipment or facilities, etc. The relationship or hierarchy between assets and entities forms the asset model. The primary relationship in the asset model is that of asset containment, where one asset contains another.
Assignable Assets	1,000	Assignable assets provide a way to assign assets to an operator's scope of responsibility. An assigned asset includes all asset children of the assigned asset including any points associated with those assets or any alarm groups that have been designated by that asset for scope of responsibility purposes. The number of assignable assets is a subset of the total number of assets.
Nesting depth for Asset hierarchies	10	
Children per Asset	No limit (up to the 4,000 total assets)	
One enterprise model is defined per system and a system can comprise multiple servers. These figures apply to the system.		

2.2.2. Alarm Groups

Items	Specifications	Comments
Alarm Groups	5,000	Alarm Groups present alarm state/status for a disparate group of points and assets that are not represented by a single asset in the asset model.
Children per Alarm Group	500	
Nesting depth for Alarm Group hierarchies	5	
One enterprise model is defined per system and a system can comprise multiple servers. These figures apply to the system.		

2.3. History Sizing

2.3.1. Collection Rates

Items	Specifications	Comments
Standard History	<ul style="list-style-type: none"> • 1 minute snapshot • 6 minute average • 1 hour average • 8 hour average • 24 hour average 	When a point is configured for Standard History collection, all of these intervals are stored.
Fast History	1, 2, 3, 4, 5, 10, 15 or 30 seconds	When a point is configured for Fast History collection, snapshots are stored at 1, 2, 3, 4, 5 (default), 10, 15, or 30 seconds. One Fast History interval can be configured per server.
Extended History	<ul style="list-style-type: none"> • 1 hour snapshot • 8 hour snapshot • 24 hour snapshot 	When a point is configured for Extended History collection, all of these intervals are stored.

To support daylight savings and time zones, all collected data is historized in Universal Coordinated Time (UCT) time.

2.3.2. Default History Files Sizes

Items		Specifications		Comments
		Time	Samples	
Standard History	1 minute snapshot	24 hours	1,442	
	6 minute average	7 days	1,682	The averages are calculated using the 1-minute base interval. That is, 6-minute averages are calculated on six 1-minute values.
	1 hour average	7 days	170	The averages are calculated using the 1-minute base interval.
	8 hour average	3 months	280	The averages are calculated using the 1-minute base interval.
	24 hour average	1 year	368	The averages are calculated using the 1-minute base interval.
Fast History	1 to 30- second snapshot	2 hours – 72 hours	8,652	
Extended History	1 hour snapshot	3 months	746	
	8 hour snapshot	1 year	281	
	24 hour snapshot	3 years	368	

The number of samples in each history file can theoretically be increased to 100,000 samples. If the size of the history file is increased beyond the default qualified size, care should be taken not to exceed the maximum history file size constraints. (See section 2.3.4). History archiving is available to store the history files for later retrieval. Experion history data is seamlessly available for use across every Experion Station for trend displays, reports, custom displays, applications, spreadsheets and ODBC compliant databases.

2.3.3. Maximum Parameters Assigned to History

Items	Specifications	Comments
Standard History	2,000	This is the default limit that Experion is shipped with. The quantity can be increased beyond the default qualified size to 50,000.
Fast History	1,000	This is the default limit that Experion is shipped with. The quantity can be increased beyond the default qualified size to 10,000.
Extended History	2,000	This is the default limit that Experion is shipped with. The quantity can be increased beyond the default qualified size to 10,000.
The ability to collect history at the configured rate depends upon throughput of underlying process control network, see table 2.4, Server Data Access Acquisition Performance. For example, for a heavily loaded ESVT there may not be sufficient LCN bandwidth to deliver 1000 parameters/second to fast history.		

2.3.4. Calculating History Space Requirements

Items	Specifications	Comments
Maximum history file size	500 MB	<ul style="list-style-type: none"> Each type of history sample is stored in a separate history file. For example, there are five history files for standard history, one each for: 1-minute snapshot, 6-minute average, and so on. An individual history file should not exceed this size.
History file size formula	History file size in bytes = $N * ((P*6) + 16)$ Where: N = number of samples P = number of parameters	Example: Number of parameters P assigned to standard history is 50,000. Number of samples N for standard 24 hours one minute snapshot is 1,442. History file size = $1,442 * ((50,000*6)+16) = 432,623,072$ bytes/ $432,623,072 / 1,048,576$ bytes/megabyte = 413 MB.

2.4. Server Data Acquisition Performance

Items	Specifications	Comments
Experion Controllers		
Maximum parameters per second (PPS) from all controllers on FTE	8,000	This includes data access to all CDA devices such as C200, C300, FIM, IOLIM, ACE, Simulation environment and LIOM.
Maximum PPS from all controllers on ControlNet	4,000	This includes data access to all CDA devices such as C200, FIM, and IOLIMs on ControlNet (not including ACE nodes – see next item)
Maximum PPS from all ACE nodes	2,000	Maximum PPS from ACE Nodes (through Ethernet or FTE) when controllers are on ControlNet
LCN¹		
Maximum values per second from LCN	1,600	
Maximum average values per second for history collection	1,200	<ul style="list-style-type: none"> This value is averaged over the entire minute. Fast and standard history may cause peak loads above this value. The ability to collect history at the configured rate depends upon the throughput of underlying process control network. For example, a heavily loaded ESVT will be limited by the usage of LCN data by other clients (such as Flex Stations and OPC data clients).
DSA		
Maximum PPS from each configured DSA subscribing server	1,000	This information is duplicated in section 3.2, DSA.
SCADA		
Maximum PPS from all configured SCADA devices	Limited by device.	
OPC		
Maximum OPC PPS from all configured OPC Servers	See section 3.2 , OPC	
Note 1 – Supported through an Experion Server – TPS (ESVT).		

2.5. Notification Performance

Items	Specifications	Comments
Alarm and Event Notifications		
Maximum number of events (burst condition) ¹	1,000 events	The Experion Server Alarm System will handle an event burst of up to 1,000 events, with a minimum time between consecutive bursts. An "event burst" is defined as a group of events greater than 40/sec, received from all connected Event Servers in a period of less than 3 seconds.
Formula to calculate the time period required between consecutive bursts, to allow for event processing	$\Delta T = BS / (40 - ER)$ Where: $\Delta T = \#$ of seconds required between bursts BS = Burst Size (number of events in the burst) ER = Event Rate between bursts	Examples: <ul style="list-style-type: none"> 1,000 event burst and no events between bursts: $\Delta T = 1,000 / 40 = 25$ seconds 500 event burst with 30 events/sec between: $\Delta T = 500 / 10 = 50$ seconds
Maximum number of sustained events/second ¹	10,000/hour, with peaks of up to 40/sec	
Maximum number of sustained alarms/second ¹	20/sec	
Maximum duration of events in online events file	5 weeks	
Maximum number of events in online events files	1.2 million	Event Archiving can be used to access older events. Approximately 60 MB of hard disk space is required for every 100,000 events archived
Alerts and Notifications		
Maximum number of alerts/second	1	
Maximum burst of alerts	100	These totals are still subject to the overall maximum number of events per second and maximum burst of events limit that the Experion servers can support.
Note 1 – The Experion Server includes the option to support OPC Alarms and Events in addition to native Experion notifications. When the Experion Server is configured to receive alarms and events from an OPC Alarm and Event Server, the notification limits noted in this table are applicable to the combined set of events received from all connected event sources.		

2.6. Supervisory Control and Data Acquisition (SCADA)

2.6.1. Communication

Items	Specifications	Comments
SCADA Channels	99	Channels typically represent a physical connection to a device, such as a device connected to one port of a terminal server. A channel can support more than one Remote Terminal Unit (RTU).
SCADA RTUs (Controllers)	255	This is the maximum number of RTUs for a given server. It is spread across all channels and includes OPC RTUs to support the OPC Client Interface as described in section 3.2.1. This information is duplicated in section 3.2, OPC Client Interface (SCADA Client).

2.6.2. Serial Adapters and Terminal Servers

Items	Qualified Devices
Serial adapters	Stallion EC8/64-PCI-K EasyConnection Smart Host Adapter PCI bus with Stallion PA-EC-8D4K 8-Port RS-232/-422/-485 Async module (DB25)
Terminal Servers	<ul style="list-style-type: none"> • Systech RCS-3282 (2 serial ports) or RCS-6008 (8 serial ports) • Stallion EasyServer II • Cisco Router
<p>The SCADA controller connection to the server depends on several factors, including the plant's layout, the type of interface used and the controller's communication port(s). For a small system, controllers can be directly connected to the server's serial ports. More serial ports can be added to the server with a serial adapter. Controllers can also be connected to the network through a terminal server.</p>	

2.6.3. Real Time Database SCADA Point Structures

Point Structure ¹	Standard Parameter		
Analog ²	Control Deadband	Scan Status	SP Low Limit
	Process Variable	OP High Limit	0% & 100% Range
	Setpoint	Scan Period	Operator Control Level
	Normal Mode	Scan Address	OP Low Limit
	Output	Control Timeout	PV Clamp Flag
	Mode	Alarm Permit Flag	Engineering Units
	SP High Limit	Alarm Status	Drift Deadband
	Up to 4 user definable inputs	Up to 8 Alarm types ³	Alarm Deadband
	Point Name	Alarm Status	Associated Display
	Point Description	PV Last Processed Time ⁴	
Status ⁵	Output Width	Output	Output Pulse Width
	Process Variable	Scan Status	Re-Alarm Status
	Control Timeout	Normal Mode	Associated Display
	Mode	Scan Period	Alarm Permit Flag
	PV Last Processed Time ³	Scan Address	Input Width
	Point Name	Alarm Priority	Control Failure Alarm Priority
	Point Description	Operator Control Level	
Accumulator ⁶	Output Width	Scan Status	Output Pulse Width
	Process Variable	Normal Mode	Re-Alarm Status
	Control Timeout	Scan Period	Associated Display
	Output	Scan Address	Input Width
	Operator Control Level	Mode	Alarm Priority
	Control Deadband	Alarm Permit Flag	PV Last Processed Time ²
	Process Variable	Control Failure Alarm Priority	SP Low Limit
	Setpoint	Scan Status	0% & 100% Range
	Normal Mode	OP High Limit	Operator Control Level

Note 1 – For each of the point types it is possible to add user-defined parameters to the existing pre-built parameters. This enables tags to be extended to contain free format values, constant values, or values used by applications and scripts to store calculated or derived plant information. User-defined parameters can be assigned to history collection.

Experion supports additional data processing through the use of standard algorithms that may be attached to an analog, status or accumulator point. Functions provided by these algorithms include:

- o Arithmetic calculations
- o Boolean calculation
- o Maximum/minimum value
- o Integration
- o Run hours totalization
- o Group alarm inhibit
- o Report request
- o Application program request

Note 2 – Used for continuous values.

Note 3 – Supported alarms include: PV Hi, PV Lo, PV HiHi, PV LoLo, Deviation Hi, Deviation Lo, Transmitter Hi, Transmitter Lo, Rate of Change, Control Fail, and Control Timeout. Each of the configured alarms can be assigned a priority ranging from Journal, Low, High to Urgent. An alarm sub-priority (0 to 15) can also be assigned to further differentiate alarms.

Note 4 – Each time the PV is polled from the RTU, Experion will track and maintain the time/date of when the value last changed, or more specifically, was last processed. If the Analog point in Experion has a drift deadband of 1%, then the last processed time is not updated until the PV moves by >1%. Similarly, if the drift deadband is 0%, then the last processed time is not updated until the PV moves slightly.

Note 5 – Used for digital values. The PV of a status point can range from a single bit to a three bit digital input, allowing up to eight possible states.

Note 6 – Used for totalizer values. Data associated with pulsed inputs are stored in the system in an accumulator point type that will provide automatic tracking of instrument rollover.

2.7. Server Scripting

2.7.1. General Server Scripting Specification

Items	Specifications	Comments
Description		
<p>Server Scripting extends the behavior of the Server-resident subsystems and its run time objects. Examples of server objects are points and parameters, reports, assets and tasks (application programs). Scripts can run by the server either periodically or when a specified event occurs. Standard displays support the monitoring of the status of running scripts.</p>		
General Specifications		
Maximum script size	Short scripts only (typically less than 50 lines)	<ul style="list-style-type: none"> Server scripting has been optimized for relatively short scripts and is not designed for implementing control strategies. If a task is computationally intensive, or requires extensive file handling, custom applications can be used instead of scripts – see section 3.5, Application Development Toolkit. Some tasks qualify for both categories, and the rules are flexible when deciding what tasks can and cannot be performed by Server scripts, see the following section. Where possible, existing server functionality should be used in preference to writing Server scripts. Standard server functionality optimizes the task implementation.

2.7.2. Server Scripting versus Custom Applications

Tasks	Server Scripting	Custom Application
Extend server functionality via information transfer	Yes	Yes
Relatively short processing (< 50 lines of code)	Yes	Yes
Used to provide linkage to other applications via automation servers	Yes	Yes
Code is interpreted at run-time.	Yes	No
Code is compiled and optimized at build time.	No	Yes
Computationally intensive	No	Yes
Optimized for supervisory control	No	Yes
Iterative code	No	Yes
Relatively complex user interface requirements	No	Yes
Extensive file handling	No	Yes
Script (program) state preserved on failover	No	No
Language	VBScript	Visual Basic, C++, etc.

3. Option Specifications

3.1. Server Redundancy

Items	Specifications	Comments
Description		
<p>Server redundancy provides a high availability platform by enabling a pair of similarly configured servers to support each other in a primary/backup fashion.</p>		
Details		
Redundancy fail-over conditions	Should the primary server fail, a fully functioning backup assumes the primary role ¹ .	
On-process migration	Provides the ability to migrate the software from a current release to the next available release without shutting down the system.	
<p>Note 1 – Primary refers to the specific server that is actively acquiring data from the controllers/RTUs and serving data to the clients. The primary server propagates all database transactions to the backup to enable both databases to remain synchronized.</p>		

3.2. Distributed Systems Architecture (DSA)

3.2.1. General DSA Specifications and Performance

Items	Specifications	Comments
Description		
Distributed System Architecture (DSA) is an option that enables multiple Experion servers to share data, alarms, alerts, messages and history without the need for duplicate configuration on any server.		
Maximum number of DSA connected servers		
Maximum number of DSA connected servers	10	Any one DSA server can subscribe from/publish to 9 other servers.
DSA Data Publish¹		
Maximum number of parameters per second (PPS) to all remote servers	2,000	
DSA Data Subscription¹		
Maximum number of PPS from each remote server	1,000	
Total number of PPS from all remote servers	9,000	
Note 1 – The ability to deliver the published data rate depends upon the throughput of the underlying process control network. For example, a heavily loaded LCN–connected Experion server may not have sufficient LCN bandwidth to deliver an additional 1,000 PPS via DSA. Refer to the documentation associated with the process control network for more information.		

3.2.2. DSA Publishing Server Communications Performance

Available Network Bandwidth ¹	Maximum Network Throughput (PPS) ²	Maximum Throughput/Server (PPS) ^{3,4}	Maximum Subscribing Servers
64 Kbps	100	100	1
128 Kbps	200	200	2
256 Kbps	400	400	3
512 Kbps	800	800	8
1 Mbps	1,000	1,000	9
2 Mbps	2,000	1,500	9
10 Mbps	10,000	2,000	9
100 Mbps	100,000	2,000	9
<p>Note 1 – “Available Network Bandwidth” means dedicated continuously available bandwidth for DSA use between the Servers, and not shared bandwidth with other applications such as Station access or Control Builder Multi-User access.</p> <p>Note 2 – Maximum traffic on any individual network segment.</p> <p>Note 3 – For Experion Servers with Process Points, the total parameter throughput caused by remote station displays, local Station displays, fast history, etc., cannot exceed 1,000 PPS.</p> <p>Note 4 – A subscribing Station is one that displays data from another publishing server through DSA. A larger number of Stations subscribing to remote data will result in a greater amount of network traffic. The absolute maximum number of subscribing Stations/publishing Servers is 20.</p>			

3.2.3. DSA Subscribing Server Communications Performance

Available Network Bandwidth ¹	Maximum Network Throughput (PPS) ²	Maximum Publishing Servers
64 Kbps	100	1
128 Kbps	200	2
256 Kbps	400	4
512 Kbps	800	6
1 Mbps	1,000	8
2 Mbps	2,000	9
10 Mbps	10,000	9
100 Mbps	100,000	9

Note 1 – “Available Network Bandwidth” means dedicated continuously available bandwidth for DSA use between the Servers, and not shared bandwidth with other applications such as Station access or Control Builder Multi-User access.

Note 2 – Maximum traffic on any individual network segment.

3.2.4. DSA Interoperability

DSA interoperability is defined as a DSA-based runtime connection between servers. The following table describes supported interoperability between various Experion and Enterprise Buildings Integrator releases.

Experion Release	Can interoperate with					
	Experion R300.1?	Experion R210.0?	Experion R201.0?	Experion R101.0?	Enterprise Buildings Integrator (EBI) R310.0?	Enterprise Buildings Integrator (EBI) R300.0?
Experion R300.1	Yes	Yes	Yes	No	Yes	No
Experion R210.0	Yes	Yes	Yes	Yes	No	Yes
Experion R201.0	Yes	Yes	Yes	Yes	No	Yes
Experion R101.0	No	Yes	Yes	Yes	No	No

General differences between releases need to be taken into account. DSA interoperability does not include interoperability of Configuration Studio engineering tools such as Control Builder, Quick Builder and Enterprise Model Builder.

3.3. OPC

3.3.1. OPC Client Interface (SCADA Client)

Items	Specifications	Comments
Description		
The OPC Client Interface is designed primarily for robust integration of low complexity subsystems such as Programmable Logic Controllers (PLCs) and Remote Terminal Units (RTUs). It provides an open method for connecting a wide range of devices for supervisory monitoring, alarming and control.		
General OPC Client Interface Specifications		
Maximum number of third party OPC DA servers supported	15	
OPC DA versions supported	1.0a and 2.05	
Supports redundant OPC DA Servers	Yes	<p>There are two options for supporting redundant third-party OPC servers:</p> <ul style="list-style-type: none"> The OPC Client interface natively supports the concept of preferred and secondary servers. However, it only supports passive redundancy, requiring the interface to rebuild the items and groups on the secondary in the event of a primary failure. This will give acceptable performance for a moderate number of items. Redirection Manager can be used as an alternative to the OPC Client Interface's built-in redundancy. With support for Active Redundancy schemes, Redirection Manager is able to build items and groups simultaneously on the OPC DA Servers. This allows for extremely fast switching in the event of an OPC DA failure.
Time-Stamping	Within the Experion server.	Time-stamping of the data occurs within the Experion server once the data has been successfully read into the SCADA database
Alarming	Yes	Alarms are generated based on limits defined within the Experion Server.
Scannable parameters per point	8 – Analog 3 – Digital 1 – Accumulator	<ul style="list-style-type: none"> A scannable parameter is a parameter that is able to source data from an OPC Item versus an internal register. These are the standard quantities of scannable parameters found on all SCADA analog, digital and accumulator points.

Items	Specifications	Comments
OPC Groups and Items		
Maximum number of OPC controllers	255	This is the maximum number of SCADA controllers/RTUs that can be built across all channels on an Experion server.
Maximum number of items per OPC controller	735	This is the total number of OPC Items that can be built against a given controller. There will be a varying number of items consumed with each point, up to 8 for an analog point.
Maximum number of OPC groups supported	500	An OPC Client controller manages groups as follows: <ul style="list-style-type: none"> • A group is created for each scan period used by the point parameters (items) defined on the controller. All point parameters that have the same scan period are placed in the same group. Note that if a scan period of 0 is used, the item is placed in a group with an update rate equal to the slowest scan rate of the server system. • All points defined on the controller have the same OPC deadband. Note that the OPC deadband is not the same as the alarm and control deadbands that can be specified for analog points.
Maximum number of items per scan period per controller	735	As above.
Rate at which items can be added to groups	1,000/second	The rate at which items can be added to groups depends upon the design of the OPC Server and the throughput of the process control network with which it connects.
OPC Group update rates supported	1 second and above	The group rates supported match the Experion scan rates supported.
OPC client callback support		
Sustained callback rate from all OPC Servers (values per second)	1,000	
OPC client write support		
Number of item writes by OPC client interface per second (per channel)	1	
Maximum no. of items per list supported (write)	10	
Sustained write rate (items/second)	1	

3.3.2. OPC Advanced Data Client

Items	Specifications	Comments
Description		
<p>The Experion OPC Advanced Data Client is designed to facilitate the efficient reading of data between Experion and OPC Data Access Servers that have very complex point structures. These point structures typically would have a large number of parameters per point and many different point types. The Experion OPC Advanced Data Client is bundled with the OPC Client Interface option.</p>		
General OPC Advanced Data Client Specifications		
Maximum number of third-party OPC servers supported	15	
OPC DA versions supported	2.05	
Redundancy Supported	Yes	<p>The OPC Advanced Data Client has no native redundancy like the OPC Client Interface; however, Redirection Manager can be used to provide redundancy support. With support for Active Redundancy schemes, Redirection Manager is able to build items and groups simultaneously on the OPC DA Servers. This allows for extremely fast switching in the event of an OPC DA failure</p>
Alarming	No	<p>Unlike the OPC Client Interface, the OPC Advanced Data Client relies on the OPC Advanced Alarm and Event client for alarming capabilities. It has no native ability to alarm without the presence of an OPC Alarm and Event (A&E) Server.</p> <p>In order for the OPC Advanced Alarm and Event client to provide alarming capabilities, condition-based OPC alarms are required from the OPC A&E Server. Because of the many different interpretations of the OPC A&E standard by third-party vendors, integration issues with OPC condition events in areas such as alarm acknowledgement and duplicate alarm identification may exist. Contact Honeywell for planning assistance when integrating a third-party OPC A&E Server that utilizes OPC condition events with Experion.</p>
Scanned parameters per point	400	
OPC Groups and Items		
Maximum number of OPC groups supported		<p>The OPC Advanced Data Client manages groups as follows: a group is created for each subscription rate used by local and remote clients. That is, all point parameters that have the same subscription rate are placed in the same group.</p> <p>When an item is no longer being subscribed to, it will be removed from its current group.</p>
Maximum number of items per group supported	2,000	
Maximum number of items across all groups	10,000	
Group update rates supported	1 second and above ^{1,2}	

Items	Specifications	Comments
OPC Client Callback Support		
Sustained callback rate from all OPC Servers (values per second)	1,000 ²	
OPC Client Write Support		
Number of item writes by OPC client interface per second	1	
Maximum no. of items per list supported (write)	2,000 ¹	
Sustained write rate (items/second)	500 ¹	
<p>Note 1 - This value depends upon the design of the third-party OPC Server and the throughput of the process control network with which it connects.</p> <p>Note 2 - The group rates supported match the Experion subscription rates supported up to the maximum subscription rate (default: 10 seconds). Beyond the maximum subscription rate synchronous reads are used to collect the data.</p>		

3.3.3. OPC Advanced Alarm and Event Client

Items	Specifications	Comments
Description		
<p>The OPC Advanced Alarm and Event Client allows Experion to seamlessly integrate third party OPC Alarm and Event data directly into the Experion Alarm and Event management system. This provides a central window for operators to view Experion Alarms and Events along with events that are coming from other sources. The Experion OPC Advanced Data Client is bundled with the OPC Client Interface option.</p>		
General OPC Advanced Data Client Specifications		
Maximum number of third-party OPC servers supported	5	
OPC A&E version supported	1.01	
Event types supported ¹	Condition, Tracking and Simple	<p>Condition-related events are associated with OPC Conditions (e.g. Acked, UnAcked, Disabled etc.). An example is the tag FIC101 transitioning into the LevelAlarm condition and HighAlarm sub-condition.</p> <p>Tracking-related events are not associated with conditions, but represent occurrences which involve the interaction of an OPC Client with a “target” object within the OPC Event Server. An example of such an event is a control change in which the operator (the OPC Client) changes the set point of tag FIC101 (the “target”).</p> <p>Simple events are all events other than the above. An example of a simple event is a component failure within the system/device represented by the OPC Event Server.</p>
Redundancy Supported	Yes	<p>The OPC Advanced Data Client has no native redundancy like the OPC Client Interface; however, Redirection Manager can be used to provide redundancy support. With support for Active Redundancy schemes, Redirection Manager is able to build items and groups simultaneously on the OPC A&E Servers. This allows for extremely fast switching in the event of an OPC A&E failure</p>
Maximum notification rate from one OPC A&E server	10,000/hour	
Maximum notification rate from all OPC A&E servers	10,000/hour	
<p>Note 1 - Because of the many different interpretations of the OPC A&E standard by third-party vendors, integration issues with OPC condition events in areas such as alarm acknowledgement and duplicate alarm identification may exist. Contact Honeywell for planning assistance when integrating a third-party OPC A&E Server that utilizes OPC condition events with Experion.</p> <p>The risks with OPC simple and tracking events are lower than for OPC condition events. However, because of different interpretations of the OPC AE standard, integration issues may still be found. Thorough testing should be performed between the Experion OPC client and third party server to ensure correct operation.</p>		

3.3.4. OPC Display Data Client

Items	Specifications	Comments
Description		
<p>Primarily targeted as a convenient method of getting OPC Data into displays. Designed for situations where you need to bring data into the Experion displays via OPC and no additional processing needs to be done on the server e.g. no need for alarming, historization, point detail, group, etc. The Experion OPC Display Data Client is bundled with the Experion base software.</p>		
General OPC Display Data Client Specifications		
Maximum number of third-party OPC servers supported	15	
OPC versions supported	2.05	
Redundancy Supported	Yes	<p>The OPC Display Data Client has no native redundancy like the OPC Client Interface; however, Redirection Manager can be used to provide redundancy support. With support for Active Redundancy schemes, Redirection Manager is able to build items and groups simultaneously on the OPC DA Servers. This allows for extremely fast switching in the event of an OPC DA failure.</p>
Alarming	No	
OPC Performance and Throughput		
Maximum number of OPC groups supported		<p>The OPC Display Data Client manages groups as follows: a group is created for each subscription rate used by local and remote clients. That is, all point parameters that have the same subscription rate are placed in the same group. When an item is no longer being subscribed to, it will be removed from its current group.</p>
Maximum number of data values per display	40	<p>The performance of third-party OPC Servers can vary significantly. For very slow OPC Servers it is possible that the maximum number of OPC display data client values per display may be less than this.</p>
Maximum number of data values per OPC server	1,000	
Display rates supported	1 second and above	<p>This value depends upon the design of the third-party OPC Server and the throughput of the process control network with which it connects.</p>
OPC client callback support		
Sustained callback rate from all OPC Servers (values per second)	100	<p>The performance of third-party OPC Servers can vary significantly. For very slow OPC Servers it is possible that the maximum number of OPC display data client values per display may be less than this.</p>

3.3.5. OPC Data Access Server

Items	Specifications	Comments
Description		
The Experion OPC Data Access Server provides OPC Data Access Clients with the capability to view Experion point data for the purposes of control and plant-wide historization.		
General OPC Data Access Server Specifications		
Maximum number of OPC clients that can be published to	15	
OPC DA versions supported	1.0 and 2.05	
Redundancy Supported	Yes	Redirection Manager should be used for connecting clients that do not support redundancy to the Redundant Experion Servers. For clients that do support redundancy, use of Redirection Manager is still advised as it has been designed with Experion's Redundancy scheme in mind.
OPC Groups and Items		
Maximum number of OPC groups supported	300	
Maximum number of items per group supported	7,000	
Rate at which items can be added to groups	1,000/second	Assumes the parameters are already primed. The rate at which items can be added to groups depends upon the throughput of underlying process control network.
Total number of items supported across all groups	50,000 ¹	
Group update rates supported	1 second and above	
OPC Client Callback Support		
Sustained callback rate from OPC Server (items per second) to all OPC clients	2,000 1	
OPC Client Read Support		
(Cache read) Maximum number of list reads from OPC Server per second	1	
(Cache read) Maximum number of items/list supported	2,000 ¹	Assumes that the data is already subscribed to and is therefore in the Experion cache.
(Device read) Maximum number of list reads from OPC Server per second	1	
(Device read) Maximum number of items/list supported	2,000 ^{1,2}	
(Device read) Sustained read rate (items/second)	500 ^{1,2}	
OPC Client Write Support		
Number of list writes to OPC Server per second	1	
Maximum no. of items per list supported (write)	2,000 ³	
Sustained write rate (items/second)	500 ³	
<p>Note 1 - Ability to deliver published data rate depends upon throughput of underlying process control network. For example, for an LCN-connected Server there may not be sufficient LCN bandwidth to deliver an additional 2,000 parameters/second via OPC. Refer to the documentation associated with the process control network for more information.</p> <p>Note 2 - Device reads should be used with caution. It is possible to overload the underlying process control network if too many device reads are performed.</p> <p>Note 3 - The ability to deliver write data rate depends upon the throughput of underlying process control network.</p>		

3.3.6. OPC Alarm and Event Server

Items	Specifications	Comments
Description		
<p>The OPC Alarm and Event Server is a simple and convenient mechanism for publishing Experion alarms and events to client applications. It provides a rich range of different Experion alarm and event data in an efficient manner, using the latest version of OPC specification.</p>		
General OPC Alarm and Event Server Specifications		
Maximum number of remote OPC A&E Clients supported	15	
OPC A&E versions supported	1.01	
Redundancy Supported	Yes	<p>Redirection Manager should be used for connecting clients that do not support redundancy to the Redundant Experion Servers. For clients that do support redundancy, use of Redirection Manager is still advised as it has been designed with Experion's Redundancy Scheme in mind.</p>
Event types supported ¹	Condition, Tracking and Simple	<p>Condition-related events are associated with OPC Conditions (e.g. Acked, UnAcked, Disabled etc.). An example is the tag FIC101 transitioning into the LevelAlarm condition and HighAlarm sub-condition.</p> <p>Tracking-related events are not associated with conditions, but represent occurrences which involve the interaction of an OPC Client with a "target" object within the OPC Event Server. An example of such an event is a control change in which the operator, (the OPC Client), changes the set point of tag FIC101 (the "target").</p> <p>Simple events are all events other than the above. An example of a simple event is a component failure within the system/device represented by the OPC Event Server.</p>
Experion Alarm and Event types published	Alarms, Alerts, Messages, Events, SOE, Operator Changes	
OPC Performance and Throughput		
Maximum notification rate to one OPC A&E client	10,000/hour	<p>The maximum notification rate is the total number of notifications received by the server from all sources. The maximum A&E notification rate is dependent on the total number of notifications being received by the server from all sources.</p>
Maximum notification rate to all OPC A&E clients	10,000/hour	As above.
<p>Note 1 - Because of the many different interpretations of the OPC A&E standard by third-party vendors, integration issues with OPC condition events in areas such as alarm acknowledgement and duplicate alarm identification may exist. Contact Honeywell for planning assistance when integrating a third-party OPC A&E Client that utilizes OPC condition events with Experion.</p> <p>The risks with OPC simple and tracking events are lower than for OPC condition events. However, because of different interpretations of the OPC AE standard, integration issues may still be found. Thorough testing should be performed between the Experion OPC A&E Server and third party client to ensure correct operation.</p>		

3.3.7. OPC Historical Data Access Server

Items	Specifications	Comments
Description		
<p>The OPC History Data Access Server presents Experion History data in an open manner to client applications. Whether archived or online, the Experion OPC History Data is able to retrieve and publish data timely and efficiently. A range of aggregate functions are provided to reduce the processing load on the client.</p>		
General OPC Historical Data Access Server Specifications		
Maximum number of simultaneous OPC HDA Clients Supported	20	
OPC HDA version supported	1.2	
Redundancy Supported	Yes	Redirection Manager should be used for connecting clients that do not support redundancy to the Redundant Experion Servers. For clients that do support redundancy, use of Redirection Manager is still advised as it has been designed with Experion's Redundancy Scheme in mind.
Supported Aggregates	Interpolated, Average, Minimum and Maximum	
Performance and Throughput		
ReadRaw (average values per second)	2500 ^{1,2}	
AdviseRaw (average values per second)	1200 ^{1,2}	
ReadProcessed (average values per second)	400 ^{1,2,3}	
<p>Note 1 - A minimum of 10 point.parameters per call are required to achieve this performance. Note 2 - The specification for value/second is across all clients. Note 3 - ReadProcessed performance is for interpolation aggregate.</p>		

3.3.8. OPC Data Access Server

Items	Specifications	Comments
Description		
<p>OPC Integrator allows bi-directional data transfer between two or more OPC Data Access Servers for the purposes of supervisory monitoring, alarming and control. As a fully integrated part of Experion, it provides integrated diagnostic, configuration and operational experiences that are consistent with other Experion operations. Additionally OPC Integrator leverages Experion’s advanced redundancy features for improved reliability.</p>		
General OPC Integrator Specifications		
OPC DA versions supported	2.05	
Maximum number of OPC Integrator transfer groups supported	Unlimited	A typical large system consists of approximately 40 groups.
Maximum number of items per group	Unlimited	Typical large systems will contain approximately 1000 items per group.
Transfer rates supported	500ms and above	<ul style="list-style-type: none"> Typically set between 1 and 10 seconds. Ability of OPC Integrator to support a given transfer rate depends on the underlying OPC Data Access Server that it is connected to. Setting this number too low can impact performance.
Rate at which items can be added to groups	1,000/second	Assumes the parameters are already primed. The rate at which items can be added to groups depends upon the design of the third-party OPC Server and the throughput of the process control network it connects to.

3.3.9. Redirection Manager

Items	Specifications	Comments
Description		
<p>Redirection Manager (RDM) provides OPC Server redundancy to OPC Data Access, Alarm and Event, and History Data Access Clients that may not support this capability by transparently redirecting client requests to a secondary OPC Server when the primary OPC Server is unavailable.</p>		
Version Support		
OPC versions supported	<ul style="list-style-type: none"> OPC DA versions 1.0 and 2.05 OPC A&E version 1.01 OPC HDA version 1.2 	

3.4. Interfaces

Interface Software ¹	Connection Type
Honeywell S9000 Integration	Ethernet
Honeywell 620 LCS Serial and Ethernet Interface	Serial and Ethernet
Honeywell UDC 3000/5000/6300 Integration	Serial ASCII
Honeywell Micromax LPU & Video Paperless Recorder	Serial
Honeywell DPR Recorders (DPR 100, 180, 250, 3000)	Serial
Honeywell RM7800 Flame Safeguard	Serial (to Q7700 Network Interface)
Honeywell Universal Modbus Interface (HC900, UMC800, Trendview, DPR180/250, UDC2300/3300, DR4300/4500)	Serial and Ethernet
Allen-Bradley (Serial Interface and RSLinx)	Serial, Ethernet, DH+, and ControlNet
Applicom Interface ²	Proprietary
Asea Interface	Serial
Bristol Babcock RTU Interface	Serial and Ethernet (Via OpenBSI API)
DNP3 Protocol Interface	Open Standard Serial and Ethernet (TCP/IP & UDP/IP)
GEC GEM80 PLC Interface	Serial
GE Fanuc Series 90 PLC via Ethernet (requires MZ-AUIF01)	Ethernet
HITACHI Interface	Serial
Modbus (RTU, Plus, ASCII, & TCP) Interface	Serial, Modbus+, ASCII and Ethernet
Moore 351,352,353,383 Interface	Serial
Siemens S5/S7 & TI PLC Via H1 / TF API ²	Industrial Ethernet
YamatakeMA500 Interface	Serial
<p>Note 1 – The Honeywell FSC and Safety Manager Serial and Ethernet Integration is standard included with the Experion base software.</p> <p>Note 2 - Applicom interface and Siemens S5 interface will be affected by third party support of the Experion Windows 2003 Server operating system. Formal guidance on this issue will be issued. The Siemens S7 Interface is not affected. Please contact Honeywell when further information about these interfaces is required.</p>	

3.5. Microsoft Excel Data Exchange

Item	Specification
Description	
Enables capture of real-time point parameter and history information, and displays the data in a Microsoft Excel spreadsheet, using cell formulas or the Microsoft Excel Data Exchange Wizard.	
Details	
Access to real-time point.parameter values	Read/write access
Access to historical point.parameter values	Read only
Access to database files (user tables)	Read/write access

3.6. Application Development Toolkit

3.6.1. ODBC Driver

Item	Specification
Description	
Primarily intended for reporting, the ODBC driver enables an ODBC-compliant application to access data in the Experion database, such as history, event, and point parameter values. With the ODBC Driver, the Experion server acts as a server application (contrast this with ODBC Data Exchange, where the Experion server acts a client application). The ODBC Driver allows the Server database to be queried using SQL commands from ODBC client applications. Additionally, custom applications written in Visual Basic or C++ can also access the server database via the ODBC driver.	
Details	
Access to real-time point.parameter values	Read only
Access to historical point.parameter values	Read only
Access to events	Read only
Configuration	Optimized for Microsoft Access and other ODBC ad hoc query/report applications.

3.6.2. ODBC Data Exchange

Item	Specification
Description	
Enables two-way exchange of data between the Experion Server database and an ODBC-compliant local or network third-party database. It uses standard Structured Query Language (SQL) commands. The Experion Server acts as a client application in this configuration, in contrast with the ODBC Driver option where the Experion Server acts a server application. Data from an Experion Server database can be transferred to a third-party database, and data from a third-party database can be transferred into the Experion Server database.	
Details	
Access to real-time point.parameter values	Read/write access
Access to historical point.parameter values	Read only
Access to database files (user tables)	Read/write access
Databases that include ODBC drivers examples	Microsoft SQL Server, Oracle 7, Microsoft Access, and Sybase 10.
Configuration options	Can be configured to periodically exchange data or exchange on request.

3.6.3. Network API

Item	Specification
Description	
Support custom applications—in Visual C/C++ or Visual Basic—that exchange data with the Experion database.	
Details	
Access to real-time point.parameter values	Read/write access
Access to historical point.parameter values	Read only
Access to database files (user tables)	Read/write access

3.7. Application Enablers

3.7.1. Alarm Pager

Items	Specifications	Comments
Protocols		
	<ul style="list-style-type: none"> • Paging Entry Terminal (PET) • Telocator Alphanumeric Protocol (TAP) • UCP protocols • UCP 01 • UCP 30 • UCP 51 	Service providers in North America generally use the PET or TAP protocols where as the UCP protocols are mainly used in Europe. The two-digit suffixes refer to the EMI command numbers used by the provider.
Sizing		
Number of Pagers	100	Each pager and email address can be configured with an individual schedule of operation so that users are only paged when they are on call.
Number of email addresses	100	
Delays		
Configurable Notification delays	0 - 60 minutes	

3.7.2. Point Control Scheduler

Item	Specification
Description	
The Scheduler option allows point supervisory control to be automatically scheduled to occur at a specified time. This may occur on a "one-shot" basis, daily, workday, weekend, holiday, or a day of the week.	
Details	
Maximum number of Point Control Schedules	1,000

3.7.3. Recipe Management

Items	Specifications	Comments
Description		
Recipe Management provides facilities to create recipes and download them to nominated process units. Each recipe may have up to 30 items and recipes can be chained together to form larger recipes, if required. Recipe items may be used to set ingredient targets, set alarm limits, set timers and place equipment into correct operating state. Items may be individually enabled for scaling.		
Details		
Maximum number of recipes	500	This is the default limit. This number can be increased to 32,000 if required.

3.7.4. Batch Reporting

Items	Specifications	Comments
Description		
Batch reporting enables integrated reporting of batches or lots of a production process run, to be compiled and archived automatically by the Experion server. This feature is standard included in the Experion base software.		
Details		
Maximum number of history samples per batch report	65,000	A batch report can collect one type of history sample (such as 5-second samples or 1-hour averages) for up to 50 points.

4. Hardware and Software Requirements

4.1. Experion Server Computer Requirements

A computer must meet the following specifications to be used as an Experion server. These guidelines are intended to provide a minimum baseline. Honeywell computer platforms will meet these specifications and carry full support as a qualified offering. ESVTs are only qualified with Honeywell computer platforms.

Minimum Experion Server Platform – This is the minimum computer platform necessary to run the Experion server components. It should only be used for small configurations that may consist of 1 Experion server or redundant server pair with 1 Flex Station and up to 3,000 SCADA points. The system typically only includes passive monitoring and occasional report generation.

Standard Experion Server Platform – This is the typical computer platform capable of running Experion server components. Configurations will consist of an Experion server or redundant server pair with up to 1 DSA server. A non-redundant server can support up to 10-12 Flex Stations or a redundant server pair can support 6-8 Flex Stations. This type of system includes 1 or 2 Flex Stations actively monitoring and occasional report generation with up to 10,000 SCADA points or up to 600 process points and up to 2 single or redundant Experion controllers.

Performance Experion Server Platform – This computer platform is used for demanding applications. An advanced configuration may consist of an Experion Server or redundant server pair, multiple DSA servers, and more than 10 Flex Stations or any number of Console Stations. This system typically includes active monitoring from multiple Stations and random report generation with more than 10,000 SCADA points or more than 600 process points and more than 2 single or redundant Experion controllers. This computer platform should also be used when the server is connected to Honeywell's Uniformance PHD.

Requirements

System Configuration	Minimum	Typical	Performance
Processor	Dual 2 GHz Xeon (32 bit) or faster	Dual 2.4 GHz Xeon (32 bit) or faster	Dual 3 GHz Xeon (32 bit) or Faster
RAM ¹	1 GB	2 GB	4 GB
Video Resolution	1024 x 768, 65K colors		
Hard Drive	80 GB	80 GB	160 GB
Video RAM	8 MB	8 MB	16 MB
Operating System	Windows 2003 Server SP1 (32-bit)		
Example Hardware Please contact your Honeywell representative for Honeywell-supplied platform details.	MZ-NTPC51, MZ-NTPC81 Dell PowerEdge 1800, 2 -CPU MZ-NTPC05 Dell PowerEdge 1600, 2 - CPU	MZ-NTPC51, MZ-NTPC81 Dell PowerEdge 1800, 2 - CPU MZ-NTPC05 Dell PowerEdge 2600, 2 - CPU	MZ-NTPC71 Dell PowerEdge 2850, 2- CPU MZ-NTPC07 Dell PowerEdge 2600, 2 - CPU
Comments		Suggested computer for a Remote Engineering and Station Server	

Note 1 – For better performance additional RAM can be added, up to a maximum of 4 GB.

4.2. Networking Requirements

Network	Comments
Fault Tolerant Ethernet ¹	Honeywell's patented Fault Tolerant Ethernet (FTE) network uses off-the-shelf networking hardware to allow Ethernet to provide "DCS network" functionality. FTE provides a robust and high availability network infrastructure for communicating to Experion Stations, C200 controllers, ACE Nodes, etc.
Ethernet	Experion Servers also support an Ethernet network infrastructure to communicate to nodes throughout the system.
ControlNet	As an option, ControlNet can be used to communicate between C200 controllers and the Experion server.
<p>Note 1 - The FTE solution employs a single logical network over redundant media. By providing more communication paths between nodes, FTE also tolerates more faults, including all single faults and many multiple faults. In addition, FTE is transparent to higher-level applications, which benefit from the high network availability that FTE provides, without requiring any additional software configuration. Normal Ethernet nodes (non-FTE) can also connect to an FTE network and benefit from a more available communications environment than conventional Ethernet redundancy schemes offer.</p>	

4.3. Minimum TPS System Specifications for ESVT

Item	Specification
Minimum APP	APP R230 Release if APP exists on target TPN
Minimum GUS	GUS R340 Release if GUS exists on target TPN
Minimum TPN Release	TPN R641.2 or later

5. Model Numbers

5.1. Server Database

Model Number	Description
EP-DBASE1 ¹	Database Base Software
EP-DPR100	100 Process Point Adder to Database Size
EP-DPR01K	1,000 Process Point Adder to Database Size
EP-DPR02K	2,000 Process Point Adder to Database Size
EP-DPR05K	5,000 Process Point Adder to Database Size
EP-DPR10K	10,000 Process Point Adder to Database Size
EP-DSC100	100 SCADA Point Adder to Database Size
EP-DSC01K	1,000 SCADA Point Adder to Database Size
EP-DSC02K	2,000 SCADA Point Adder to Database Size
EP-DSC05K	5,000 SCADA Point Adder to Database Size
EP-DSC10K	10,000 SCADA Point Adder to Database Size
<p>Note 1 – Every Experion Server requires base software at a minimum. The base software includes the following items: 1 Experion Station-Flex (client-connected HMI/web-based human interface), 50 SCADA points, 50 process points, 1 Quick Builder License, Redirection Manager, OPC Display Data Client, Honeywell FSC and Safety Manager Integration, Batch Reporting, 1 Display Builder License and 1 Control Builder Client License (enables the configuration of control strategies for CDA devices such as the C200, C300 and ACE). The base license also includes other options and interfaces as listed in the Experion Server License Specification.</p>	

5.2. Experion Server TPS Enabler

Model Number	Description
EP SRVTPS ¹	Experion Server TPS Enabler
<p>Note 1 – Requires EP-DBASE1 and an LCN-connected PC Platform purchased from Honeywell. It enables the base software to also support TPS points. An LCN supports one ESVT (or redundant pair).</p>	

5.3. Server Redundancy

Model Number	Description
EP-RBASE1 ¹	Redundancy Base Software
EP-RPR100	100 Process Points Redundancy Adder
EP-RPR01K	1,000 Process Points Redundancy Adder
EP-RPR02K	2,000 Process Points Redundancy Adder
EP-RPR05K	5,000 Process Points Redundancy Adder
EP-RPR10K	10,000 Process Points Redundancy Adder
EP-RSC100	100 SCADA Points Redundancy Adder
EP-RSC01K	1,000 SCADA Points Redundancy Adder
EP-RSC02K	2,000 SCADA Points Redundancy Adder
EP-RSC05K	5,000 SCADA Points Redundancy Adder
EP-RSC10K	10,000 SCADA Points Redundancy Adder
Note 1 – Includes On-Process Migration Support. Redundancy software must equal the licensed SCADA and Process points mix.	

5.4. Distributed System Architecture

Model Number	Description
EP-XRESR1	DSA Remote Server License
Note 1 – Each Experion Server is enabled to publish data in a DSA design. EP-XRESR1 is required once for a server or redundant server pair that needs to subscribe to data. One DSA remote Server license is required to subscribe to up to the maximum number of 9 servers.	

5.5. OPC

Model Number	Description
EP-OPCCLI ¹	OPC Client Interface
EP-OPCINT	OPC Integrator, per connection
EP-OPCDA1	OPC Data Access Server, per connection
EP-OPCSAE	OPC Alarm & Event Server, per connection
EP-OPCHDA	OPC History Data Access Server, per connection
Note 1 – Includes the OPC Advanced Client.	

5.6. TDC3000 Data Hiway Integration

Model Number	Description
EP-IHWTDC	Honeywell TDC 3000 Data Hiway Integration
MZ-PCDB22	Data Hiway Ethernet Bridge (DHEB)

5.7. Honeywell Device Integration

Model Number	Description
EP-IHWS9K	Honeywell S9000 Integration
EP-IHW620	Honeywell 620 LCS Serial and Ethernet Interface
EP-IHWUDC	Honeywell UDC 3000/5000/6300 Integration
EP-IHWMMX	Honeywell Micromax LPU & Video Paperless
EP-IHWDPR	Honeywell DPR Recorders (DPR 100, 180, 250, 3000)
EP-IHWFSG	Honeywell RM7800 Flame Safeguard
EP-IHUMB	Honeywell Universal Modbus Interface

5.8.

5.9. SCADA Interfaces

Model Number	Description
EP-IDNP3P	DNP3 Protocol Interface
EP-IMDBUS	Modbus (RTU, Plus, ASCII, & TCP) Interface
EP-IABRI1 ¹	Allen-Bradley Interface
EP-IRSL24 ¹	Allen-Bradley RSLINX Software, Ver. 2.4
EP-IGES90	GE Fanuc Series 90 PLC via Ethernet (requires EP-IGEAPI)
EP-IGEAPI	GE API License
EP-ISMNS5	Siemens S5/S7 & TI PLC Via H1 / TF API
EP-IGEM80	GEC GEM80 PLC Interface
EP-IYTMA5	Yamatake MA500 Interface
EP-IBBRTU	Bristol Babcock RTU Interface
EP-IMR35X	Moore 351, 352, 353, 383 Interface
EP-IHTCHI	HITACHI Interface
EP-IASEAI	Asea Interface

Note 1 – Includes the Allen-Bradley Serial Interface, the Allen-Bradley RSLinx interface and Allen-Bradley Integration. When the RSLinx interface is utilized, RSLinx is required (EP-IRSL25). RSLinx is available in a variety of packages with varying degrees of functionality. One feature of RSLinx is the exposure of underlying device data via an OPC Data Access Server. RSLinx OEM, the package provided with this model number only allows non-remote (OPC client resident on the same PC as RSLinx) OPC clients to connect to the OPC Server. If the OPC Data Access Server of RSLinx is required and must be accessed by remote OPC clients, please purchase the RSLinx Gateway version directly from Rockwell Automation or a distributor.

5.10. Microsoft Excel Data Exchange

Model Number	Description
EP-AEED1	Microsoft Excel data Exchange, per user

5.11. Application Toolkit

Model Number	Description
EP-AEAPD1	Application Development Toolkit

5.12. Application Enablers

Model Number	Description
EP-AERMGR	Recipe Manager
EP-AESHED	Point Control Scheduler
EP-AEPAGE	Alarm Pager

5.13. Engineering Tools

Model Number	Description
EP-TQBLDR	Quick Builder – SCADA database builder, per user
EP-TDSPBD ¹	Display Builder, per user
Note 1 – Includes HMIWeb Display Builder and Display Builder.	

5.14. Electronic Signature

Model Number	Description
EP-ESIG01	Electronic Signature Option
Provides the necessary functions, such as Electronic Signature support, for regulated industries. The Experion Server provides enhanced capabilities to support the Pharmaceutical industry and other FDA regulated industries and their unique requirements related to regulations such as 21 CFR Part 11. These features may be employed in any industry but are specifically designed to meet the guidelines of 21 CFR Part 11.	

5.15. Experion Server Hardware

Model Number	Description
MZ-NTPC51	Tower Server Platform, dual 3.4GHz Xeon, 1GB RAM, 36GB HD, Windows Server 2003
MZ-NTPC81	Tower Server Platform, dual 3.4GHz Xeon, 1GB RAM, 36GB RAID1, Windows Server 2003
MZ-NTPC71	2U Rack Server Platform, dual 3.4GHz Xeon, 2GB RAM, 108GB RAID5, Windows Server 2003
MZ-PCEM34	1 GB RAM Expansion for MZ-NTPC51, -71, -81 platforms
MZ-PCEM42	2 GB RAM Expansion for MZ-NTPC51, -81 platforms
NE-NICS01	100Mbps dual port FTE interface for MZ-NTPC51, -81 platforms (not needed for MZ-NTPC71)
MZ-PCEB32	100Mbps single port Ethernet interface for server platforms
TP-LCNP02	Honeywell LCN Connection – required for LCN-connected Server.
TC-PCIC02	ControlNet interface for server platforms
TP-DFP191	19" Desktop Flat Panel Display
TP-FPD203	20.1" Desktop Flat Panel Display
TP-FPT203	20.1" Desktop Flat Panel Display with Touchscreen
TP-DFP191	19" Desktop Flat Panel Display
MZ-PCDT03	Terminal Server-8 RS232 Ports, RJ45
MZ-PCEB11	8 Port RS-232/422/485 Expansion Module
MZ-PCDD06	Trackball w/PS-2 Connector
MZ-NTPC51	Tower Server Platform, dual 3.4GHz Xeon, 1GB RAM, 36GB HD, Windows Server 2003
MZ-NTPC81	Tower Server Platform, dual 3.4GHz Xeon, 1GB RAM, 36GB RAID1, Windows Server 2003
MZ-NTPC71	2U Rack Server Platform, dual 3.4GHz Xeon, 2GB RAM, 108GB RAID5, Windows Server 2003
MZ-PCEM34	1 GB RAM Expansion for MZ-NTPC51, -71, -81 platforms
MZ-PCEM42	2 GB RAM Expansion for MZ-NTPC51, -81 platforms
NE-NICS01	100Mbps dual port FTE interface for MZ-NTPC51, -81 platforms (not needed for MZ-NTPC71)
MZ-PCEB32	100Mbps single port Ethernet interface for server platforms
MZ-PCDD06	Trackball w/PS-2 Connector

6. Glossary

Term or Acronym	Description
ACE	Application Control Environment. Experion controller node hosted on a server computer platform. The ACE node is ideally suited for supervisory control solutions and integration with third party control systems.
APP	Application Processing Platform. Application node for the Honeywell TotalPlant Solution (TPS) system.
C200	A specific type of Honeywell Process Controller
C300	A specific type of Honeywell Process Controller based on the series C form factor
CDA	Control Data Access is the Experion system communication infrastructure and data access interface schema that provides application integration with Experion system objects.
ControlNet	Real-time control-layer network.
DCS	Distributed Control System
DSA	Distributed System Architecture
EBI	Enterprise Building Integrator. Suite of integrated facility management applications.
ES-C	Experion Station – Console
ES-CE	Experion Station – Console Extension
ES-F	Experion Station –Flex
ES-T	Experion Station –TPS
ESVT	Experion Server – TPS
Experion Server	The node (optionally redundant) at the heart of Experion. The servers encompasses a wide range of subsystems including history collection, SCADA interfaces, alarm/event, etc.
FIM	Foundation Fieldbus Interface Module
FTE	Fault Tolerant Ethernet, the Experion control network
HMI	Human Machine Interface
HMIWeb	Human Machine Interface based on Web Technology
HTML	Hypertext Markup Language
IOLIM	IO Link Interface Module. Services and processes all communications between the Experion Controllers and Process Manager I/O (PMIO)
LCN	Local Control Network
OPC	Series of standard specification for open connectivity in industrial automation, originally based on Microsoft's OLE COM and DCOM technologies.
PPS	Parameters per second
RTU	Remote Terminal Unit
SCADA	Supervisory Control and Data Acquisition
TPN	Total Plant Network
TPS	TotalPlant Solution
Uniformance PHD	Flexible environment for the collection, storage and analysis of process data. A Process History Database (PHD) database may be centrally configured and managed, gathering data from many systems including Honeywell Experion PKS and TotalPlant Solution (TPS), OPC Servers, and other third-party sources.

Experion, PlantScape and TotalPlant are registered trademarks of Honeywell International Inc. All other products and brand names shown are trademarks of their respective owners.

While this information is presented in good faith and believed to be accurate, Honeywell disclaims the implied warranties of merchantability and fitness for a particular purpose and makes no express warranties except as may be stated in its written agreement with and for its customer. In no event is Honeywell liable to anyone for any indirect, special or consequential damages. The information and specifications in this document are subject to change without notice

This document that is published for the sole usage of Honeywell Process Solutions' customers and prospective customers

For More Information

Learn more about Honeywell's products/solutions visit our website www.honeywell.com/ps or contact your Honeywell account manager.

Automation & Control Solutions

Process Solutions
Honeywell
2500 West Union Hills Drive
Phoenix, AZ 85027
Tel: 877.466.3993 or 602.313.6665
www.honeywell.com/ps

EP03-200-300
August 2006
© 2006 Honeywell International Inc.

The Honeywell logo is displayed in a bold, red, sans-serif font.